

All tests in this report are executed according to the ISO 9001 certified Quality management system of the BBRI

Test Centre	B-1342 Limelette, avenue P. Holoffe 21	Tel.: +32 (0)2 655 77 11
Offices	B-1932 Sint-Stevens-Woluwe, Lozenberg 7	Tel.: +32 (0)2 716 42 11
Head Office	B-1000 Bruxelles, rue du Lombard 42	Tel.: +32 (0)2 502 66 90


TEST REPORT

Laboratory Air Quality and Ventilation	O/References	DE 633X203 VE 293/2/EN/EXT Page 1/5
---	---------------------	---

Date of order of the extension	30-06-2014	Samples registration	N-2014-10-012
		Date of reception of samples	07-02-2014
Date of issue of the report	02-06-2014	Date of the test	10-03-2014
Test carried out	Measurement of the casing leakage of a damper or valve		
References	NBN EN 1751:2014 Ventilation for buildings - Air terminal devices - Aerodynamic testing of dampers and valves		

*This test report contains 5 pages and may only be reproduced in its entirety.
 Each page of the report has been stamped (in red) by the laboratory and initialed by the head of laboratory.
 The results and findings are only valid for the tested samples.*

- No sample
- Sample(s) subjected to destructive test
- Sample(s) to be removed from our laboratories 30 calendar days after sending of the report, save in the case of a further written request.

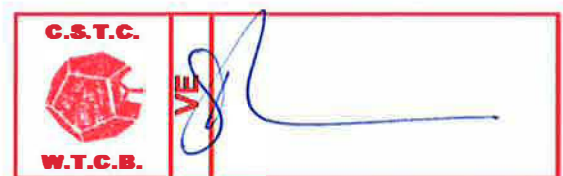

In charge of the tests
Philippe Voordecker

Head of laboratory
Christophe Delmotte, Ir.

Test procedure

The determination of the casing leakage of a damper or valve is carried out according to NBN EN 1751:2014 «Ventilation for buildings - Air terminal devices - Aerodynamic testing of dampers and valves».


The test installation comprises the following:

- an adjustable air supply incorporating an air flow rate measuring device;
- a pressure measuring device;
- an airtight test duct which supports the damper or valve subject to the test;
- a blanking plate for the damper or valve.

The test is carried out by subjecting the casing of the damper or valve to a pressure of 2000 Pa. The pressure is then lowered in stages. The air flow rate is recorded at each of the pressure stages.

If temperature and barometric pressure are different from the standard conditions (20 °C and 101325 Pa), the measured airflows are corrected accordingly.


Normalized values are determined through a linear regression.

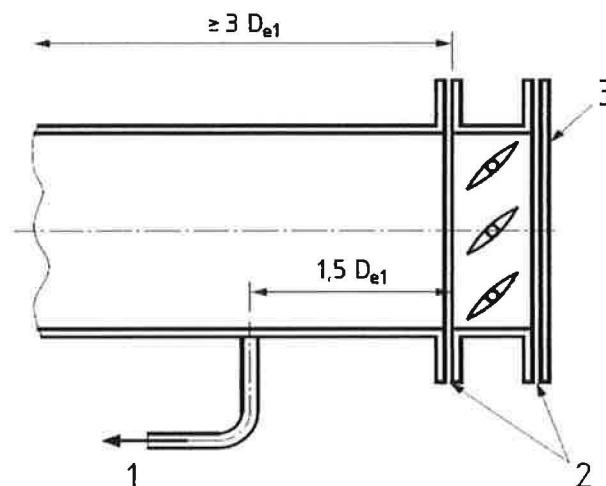

Key

- 1 to manometer
- 2 sealed joints
- 3 blanking plate

Principle of test installation according to NBN EN 1751:2014

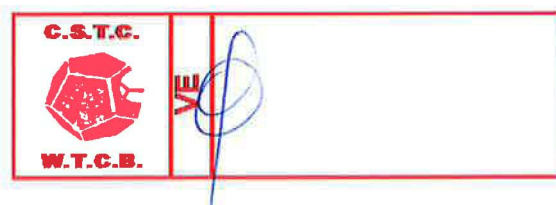

Description of the sample
 Iris damper with a nominal diameter of 160 mm (IRIS 160)

Date of test: 10-03-2014

Measuring devices:

Platon GTLK

Calibration:

22-05-1989

Organization:

Platon

Airflow TA460-P

18-06-2013

TSI Airflow

Testo 720 n°5

13-11-2013

CSTC-WTCB

Airflow TA460-P

18-06-2013

TSI Airflow

Measurement conditions:

Air temperature

20,0 °C

Barometric pressure

100745 Pa

Reference casing area:

Perimeter of the damper

0,503 m

Reference area

0,503 m²

Measured values

Static pressure p_s (Pa)	Leakage air flow $q_{VL, meas}$ (l/s)
201	0,003
404	0,005
619	0,007
805	0,008
1006	0,010
1228	0,012
1417	0,014
1628	0,017
1790	0,019
1811	0,016
2034	0,02

Corrected values

Case leakage air flow q_{VLCA} (l/s.m ²)
0,005
0,009
0,013
0,016
0,020
0,024
0,028
0,033
0,038
0,031
0,04



Normalized values

Classification of case leakage: Class C

Static pressure (Pa)	Leakage air flow (l/s)	Flow rate / pressure characteristic
250	0,003	$q = C \Delta p^n$ (l/s)
500	0,005	
1000	0,010	$C = 0,000021$ (l/s. Pa ⁿ)
1500	0,015	$n = 0,8955$ (-)
2000	0,019	

